

Grange

Infiltration Reduction Plan

Last Updated: November 2024



Executive summary

Grange in Cumbria is currently in the survey stage (see Figure 1) to address infiltration and reduce spills at the Grange Pumping Station Storm Overflow (LAK0074SO). A desktop assessment concluded that there is the possibility of groundwater infiltration but not likely a significant amount that would reduce spill count if addressed. Surveys are underway to clarify this.

If groundwater infiltration is found to be a leading cause of spills, interventions will be assessed and this Infiltration Reduction Plan will be updated accordingly. If not, this plan will end at the survey stage and next steps will be processed through other relevant workstreams.

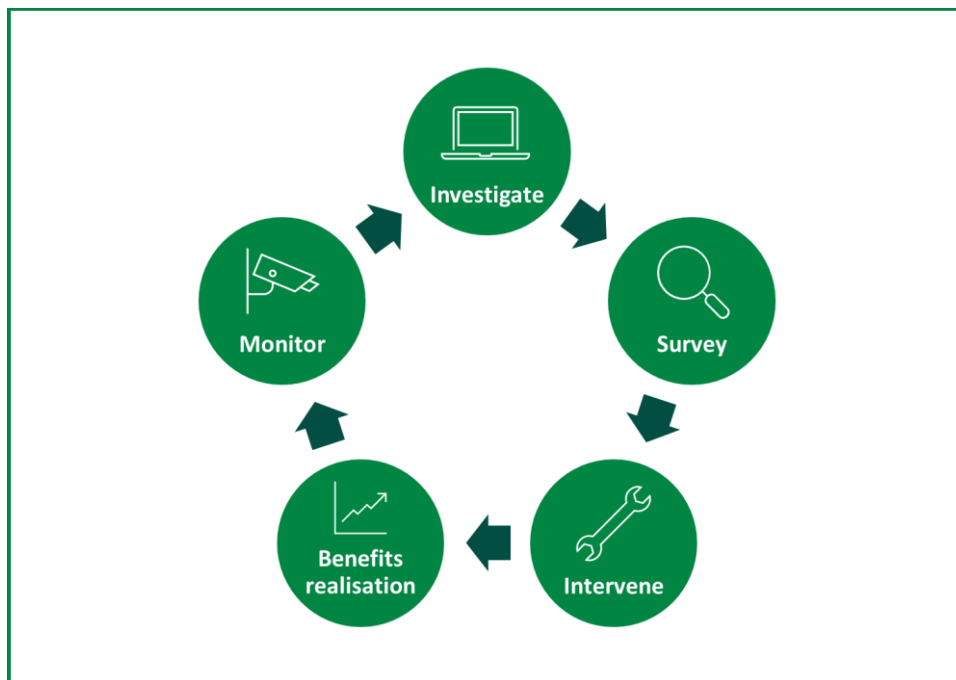


Figure 1: Iterative process to investigate, identify and address groundwater infiltration

Context

Sometimes, water can enter our wastewater pipes that they were not designed to receive. One source of these additional flows can be groundwater infiltration which can occur through pipe defects, leaky joints or issues with manholes. Extra water in the network can cause the sewer capacity to be exceeded, leading to sewer flooding or contributing to storm overflow activations.

As part of our ongoing work to maintain an effective network and achieve Better Rivers for the North West, our Infiltration Reduction Plans demonstrate our efforts to date and next steps to address infiltration and inflows in the catchment. This plan covers the Grange PS drainage area and the associated overflow, Grange Pumping Station Storm Overflow (LAK0074SO). In 2022, infiltration was identified as a potential leading cause of the storm overflow discharging. The purpose of this plan is to further investigate and address this. If groundwater infiltration is found to be a leading cause of spills, interventions will be assessed and this Infiltration Reduction Plan will be updated accordingly. If not, this plan will end at the survey stage and next steps will be processed through other relevant workstreams.

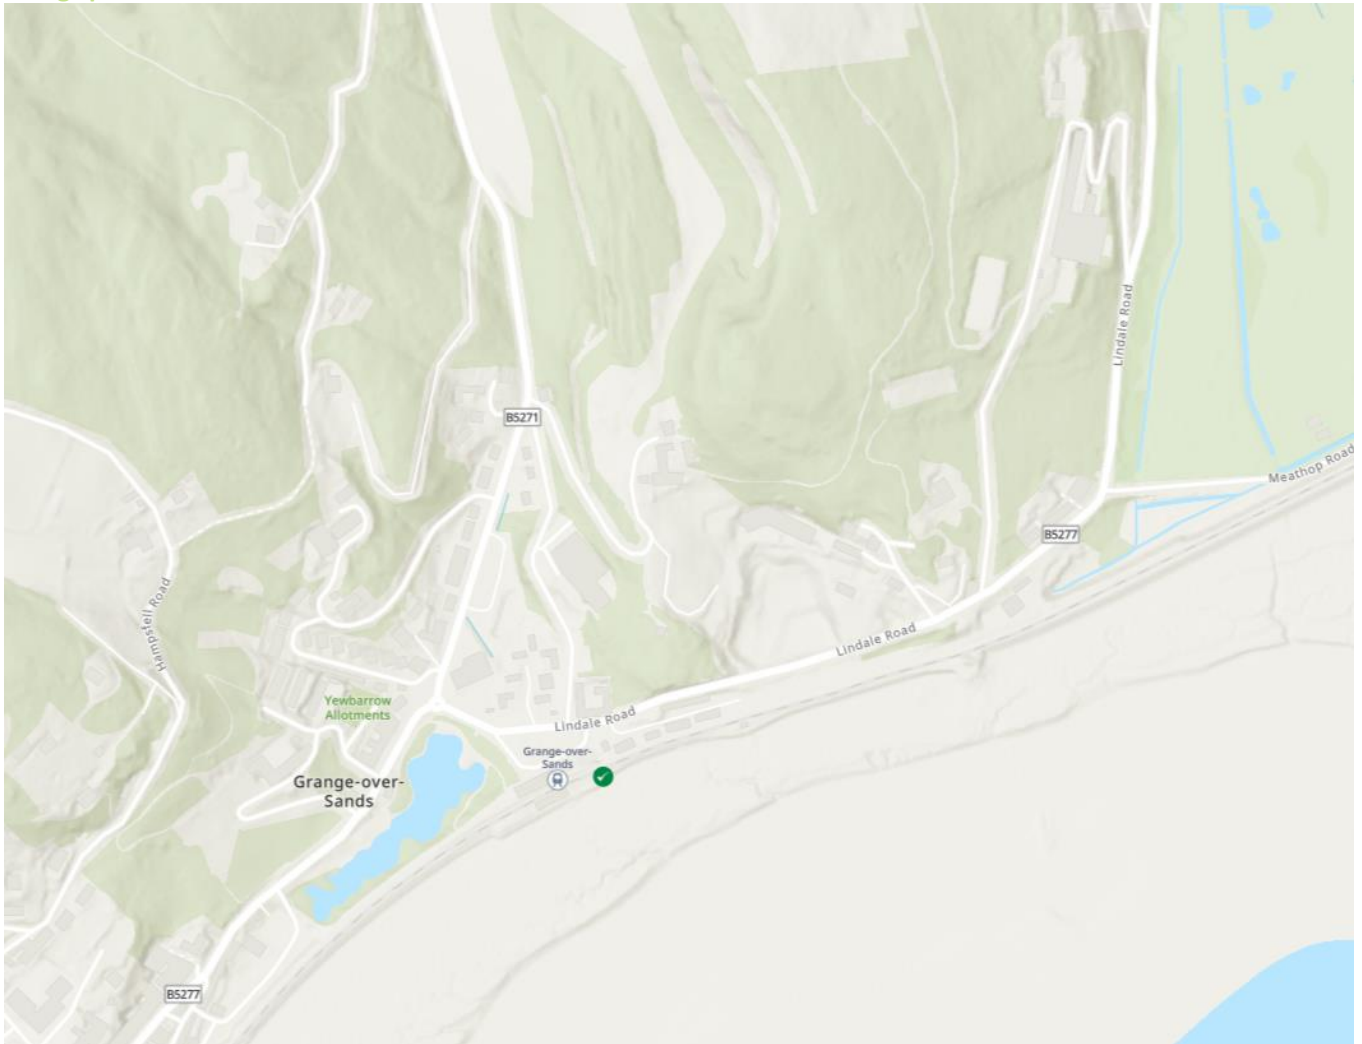


Figure 2: United Utilities – Better Rivers – Storm Overflow Map (November 2024). The green dot marks the Grange Pumping Station Storm Overflow

Grange-over-sands lies on the northern stretch of Morecambe Bay in Cumbria. It is surrounded by coastal and upland area and lies just outside of the Southern Lake District National Park border. The mixture of woodland, farmland, hills, urban areas and the estuary creates a unique catchment landscape.

Investigate

A desktop study was undertaken using available data to understand the extent of infiltration in the sewer network of the drainage catchment. The following data (where available) was analysed to determine the scale and location of potential infiltration:

- Relevant flow and depth data
- Operational information
- MCERTS data
- Hydraulic models of the catchment
- River levels
- Groundwater (borehole) data
- Spill analysis
- Topographical and sewer maps

The assessment concluded that significant groundwater infiltration was unlikely in the catchment. Some evidence of base infiltration in the system was identified, as well as rainfall driven run off and areas of the catchment where water bodies run next to sewers and highways where public sewers are located. Flow could enter the system through highway gullies and therefore, further investigation was recommended.

From these findings, it was recommended that CCTV surveys are completed to see if there is infiltration into the sewer. The CCTV survey should also identify if there is land drainage connected into the sewer, which would be assessed for removal.

Survey

Comprehensive CCTV surveying of the area is planned for Winter 2024 to identify possible infiltration and inflows to the sewer. This may be extended to Winter 2025 if surveying is not conclusive. The CCTV survey information will then be assessed using Artificial Intelligence to identify outstanding infiltration and inflow issues that need addressing.

Next steps

Grange is currently in the surveying stage of identifying and addressing infiltration (see Figure 1). If the CCTV survey reveals groundwater infiltration, interventions will be considered, and the site will follow an iterative intervention regime to monitor the efficacy of the solution. Remedial works at Grange could include, but not be limited to, relaying sewers, lining sewer or sealing manholes. This would be expected to be completed in 2025.